



JOHNSTON COUNTY ENVIRONMENTAL HEALTH DEPARTMENT

309 East Market Street
Smithfield, North Carolina 27577
Telephone: (919)989-5180 · Fax: (919) 989-5190
www.johnstonnc.com/envhealth2


Application # 114956 **Parcel #** D56040105
Name : Lee Woods LLC **Address:** 28 Lee Woods Dr. Clayton, NC.
Location: SR-1560
Subdivision: Lee Woods **Lot # :** 1 **Lot Area:** .72 **Acre(s)** Water Source: Public
Facility Type: SFD - 3-Bedroom **Daily Flow For Design:** 120x3 **DDSF:** 360 gallons/day
Service Type: New **Soil Site Classification:** P.S. **LTAR:** .4 gallons/day/ft²
Septic Tank: 900g+ gallons **Grease Trap:** - gallons **Pump Tank:** - gallons
Trench Type: Gravel or Accepted **Trench Area:** 900 ft² **# of Lines:** 3
Width: 3 Feet feet **Length:** 100' feet **Depth:** 22" inches
Pump Size: - ft TDH @ - gallons/minute **Pressure Head:** - **Drawdown:** - inches
Design/Layout by: R. Mills **Improvement Permit:** R. Mills **Date:** 5-22-15 **Exp. Date:** 5-22-20
Inspection: **Lines:** - **Septic Tank:** - **D-Box:** -
Pump Tank: - **Pump(s) Pressure:** - **Alarm:** -
Grease Trap: - **Drainage:** - **Contractor:** -

AUTHORIZATION FOR WASTEWATER SYSTEM CONSTRUCTION

ISSUED BY: Robert Mills Jr. **DATE ISSUED:** 5-22-15

By rule, this septic system requires the use of an effluent filter and a waterproof seal. A riser and septic marker may also be required. Systems shall be installed as shown in sketch and/or according to attached plans and specifications. Any unauthorized site disturbance, filling, soil removal, or layout changes may result in the permit being revoked. Improvement permit is valid for 5 years from the date of issuance unless otherwise indicated. The owner/agent accepts & verifies the conditions of the permit as indicated below. Maintenance is required to ensure proper operation.

OWNER/AGENT: [Signature] **DATE:** 6/1/15

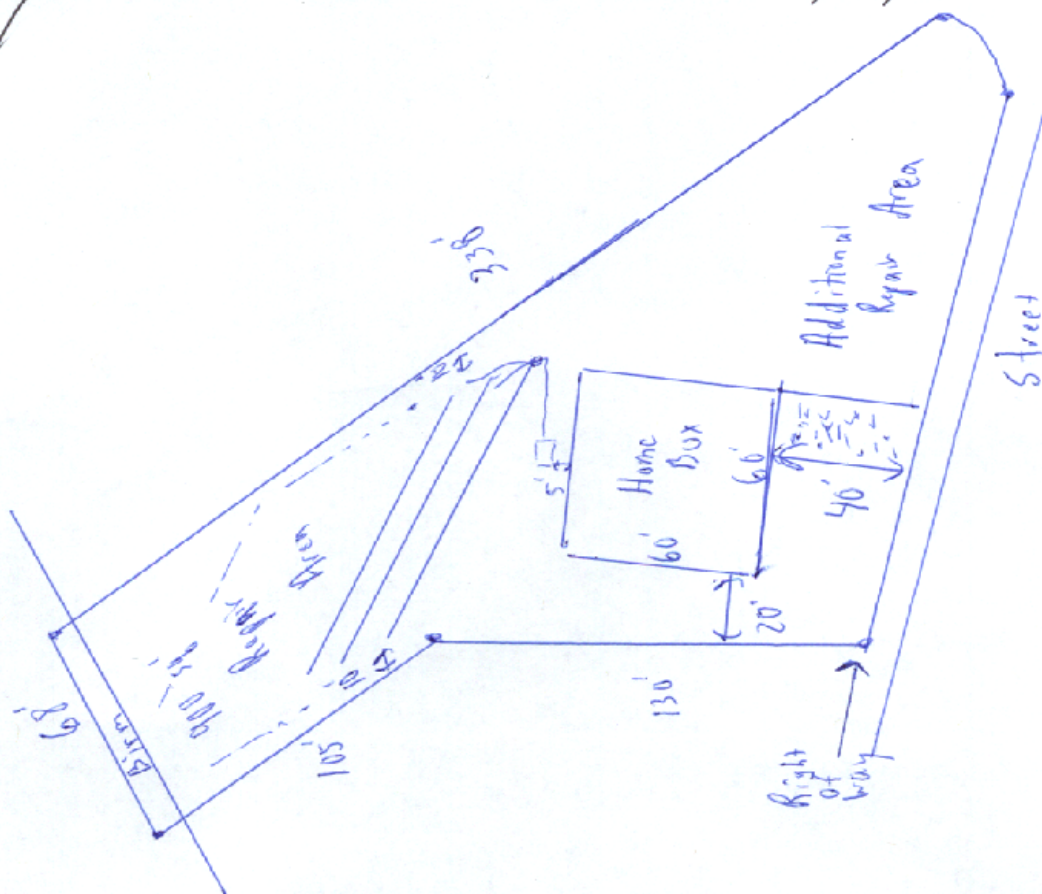

OPERATION PERMIT BY: - **DATE:** -