

SEPTIC TANK INSPECTION RECORD

Code

Environmental Health Division

Date

Gaston County Health Department

Permit By

Owner

OCCUPANT

OWNER

LOCATION

DESIGNED FOR:

3 Bedrooms, Washing Machine, Garbage Disposal; not more than 6 persons.

SEPTIC TANK: capacity

1000gallons; Block, Precast

Mfg.

NITRIFICATION FIELD:

450

feet of 30 inch ditch:

5

lines in

one

bed (s)

90 feet long12 1/2 feet wide.4 inch concrete plastic terra cotta drain tile:8inches of crushed stone, with 6 inches under tile.

Seepage pit (s)

feet long.

feet wide.

feet stone.

No. lines

SAND FILTER:

feet long

feet wide with

lines on top and

lines on

bottom. inch tile.

WATER SUPPLY:

Municipal

PublicSemi-private

Private


CONTRACTOR:

Glenn Carley, Inc.

INSPECTED BY:

B. Carley

LOCATION

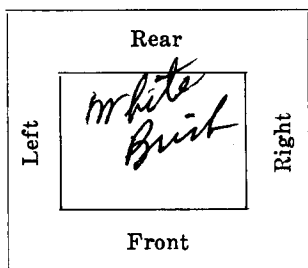

HOUSE SEWER: 15 feet from right, left, front, rear corner.

SEPTIC TANK: Front, rear, right side, left side of building. Perpendicular, parallel, angle 33 feet from building.

DISTRIBUTION BOX: 10 feet from end, side, corner of septic tank.

NITRIFICATION FIELD OR FILTER: 35 feet from building at nearest point.

WELL (IF ANY): 100 ft feet from septic tank and 100 ft feet from disposal field.

SOIL APPEARANCE: Average, above average, poor.

REMARKS: _____
